

ONEFLOR USA ACOUSTICAL PERFORMANCE TEST REPORT

SCOPE OF WORK

ASTM E90 AND ASTM E492 TESTING ON
3.5 MM ONEFLOR USA SETAGRIP/SETADB/CLING/CLING COMFORT LVT FLOORING

SPECIMEN TYPE

Open Web Truss - 457 mm

REPORT NUMBER

P6745.01-113-11-R0

TEST DATE

01/23/23

ISSUE DATE

01/24/23

RECORD RETENTION END

01/23/27


PAGES

15

DOCUMENT CONTROL

RTTDS-R-AMER-Test-2844 (03/23/22)

© 2017 INTERTEK

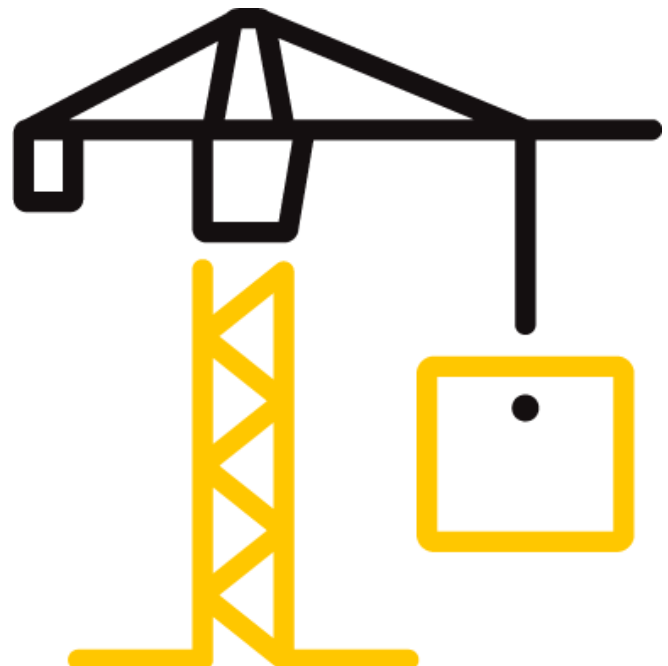

TEST REPORT FOR ONEFLOR USA

Report No.: P6745.01-113-11-R0

Date: 01/24/23

REPORT ISSUED TO

ONEFLOR USA

12510 West Airport Boulevard
Sugar Land, Texas 77478

SECTION 1

SCOPE

Architectural Testing, Inc. (an Intertek company) dba Intertek Building & Construction (B&C) was contracted by OneFlor USA to perform testing in accordance with ASTM E90 AND ASTM E492 on 3.5 mm OneFlor USA Setagrip/SetaDB/Cling/Cling Comfort LVT Flooring. Results obtained are tested values and were secured by using the designated test methods. Testing was conducted in the VT test chambers at Intertek B&C located in York, Pennsylvania.

This report does not constitute certification of this product nor an opinion or endorsement by this laboratory.

SECTION 2

SUMMARY OF TEST RESULTS

DATA FILE NO.	P6745.01
SERIES/MODEL:	3.5 mm OneFlor USA Setagrip/SetaDB/Cling/Cling Comfort LVT Flooring
STC	60
IIC	52
HIIC	59

COMPLETED BY:	Corey S. Kohler
	Technician - Acoustical
TITLE:	Testing
SIGNATURE:	
DATE:	01/24/23

REVIEWED BY:	Daniel B. Mohler
	Project Manager - Acoustical
TITLE:	Testing
SIGNATURE:	
DATE:	01/24/23

This report is for the exclusive use of Intertek's Client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this report. Only the Client is authorized to permit copying or distribution of this report and then only in its entirety. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. The observations and test results in this report are relevant only to the sample(s) tested. This report by itself does not imply that the material, product, or service is or has ever been under an Intertek certification program.



TEST REPORT FOR ONEFLOR USA

Report No.: P6745.01-113-11-R0

Date: 01/24/23

SECTION 3**TEST METHODS**

The specimen was evaluated in accordance with the following:

ASTM E90-09 (2016), *Standard Test Method for Laboratory Measurement of Airborne Sound Transmission Loss of Building Partitions*

ASTM E413-22, *Classification for Rating Sound Insulation*

ASTM E492-22, *Standard Test Method for Laboratory Measurement of Impact Sound Transmission Through Floor-Ceiling Assemblies Using the Tapping Machine*

ASTM E989-21, *Classification for Determination of Impact Insulation Class (IIC)*

ASTM E2235-04 (2020), *Standard Test Method for Determination of Decay Rates for Use in Sound Insulation Test Methods*

ASTM E3207-21, *Standard Classification for Determination of Low-Frequency Impact Sound Ratings*

ASTM E3222-20, *Standard Classification for Determination of High-Frequency Impact Sound Ratings*

SECTION 4**MATERIAL SOURCE/INSTALLATION**

The full test specimen was assembled on the day of testing by B&C. All materials provided by the client were installed on an existing B&C assembly (Open Web Truss - 457 mm) utilizing B&C-supplied materials. The assembly was installed in a steel test frame which was installed into the opening between the source and receive rooms in the test chamber. The test frame was isolated from the structure with dense neoprene gasket.

The total weight of the floor/ceiling assembly was 852.8 kg. B&C will store samples of the test specimen for four years. Photographs of the test specimen are included in the report. A drawing of the test specimen is included in the report.

B&C will service this report for the entire test record retention period. Test records, such as detailed drawings, datasheets, representative samples of test specimens, or other pertinent project documentation, will be retained by B&C for the entire test record retention period.

Unless differently required, Intertek reports apply the "Simple Acceptance" rule, also called "Shared Risk approach," of ILAC-G8:09/2019, Guidelines on Decision Rules and Statements of Conformity.

TEST REPORT FOR ONEFLOR USA

Report No.: P6745.01-113-11-R0

Date: 01/24/23

**SECTION 5
EQUIPMENT**

INSTRUMENT	MANUFACTURER	MODEL	DESCRIPTION	ASSET #	CAL DATE	
2-Channel Analog Input	National Instruments	NI 9250	2-Channel Analog Input	INT02586	04/22	*
2-Channel Analog Input	National Instruments	NI 9250	2-Channel Analog Input	INT02587	04/22	*
2-Channel Analog Input	National Instruments	NI 9250	2-Channel Analog Input	INT02608	04/22	*
2-Channel Analog Input	National Instruments	NI 9250	2-Channel Analog Input	INT02609	04/22	*
2-Channel Analog Input	National Instruments	NI 9250	2-Channel Analog Input	INT02610	04/22	*
2-Channel Analog Input	National Instruments	NI 9250	2-Channel Analog Input	INT02612	04/22	*
2-Channel Analog Output	National Instruments	NI 9260	2-Channel Analog Output	INT02573	04/22	*
Microphone Calibrator	Norsonic	34093	Acoustical Calibrator	65105	10/22	
Receive Room Microphone	PCB Piezotronics	378C20	Microphone and Preamplifier	63741	06/22	
Receive Room Microphone	PCB Piezotronics	378B20	Microphone and Preamplifier	63740	04/22	
Receive Room Microphone	PCB Piezotronics	378B20	Microphone and Preamplifier	65969	06/22	
Receive Room Microphone	PCB Piezotronics	378B20	Microphone and Preamplifier	63747	01/22	
Receive Room Microphone	PCB Piezotronics	378B20	Microphone and Preamplifier	65968	01/22	
Receive Room Environmental Indicator	Comet	T7510	Temperature and Humidity Transmitter	63812	10/22	
				63811	10/22	
Source Room Microphone	PCB Piezotronics	378C20	Microphone and Preamplifier	65103	02/22	
Source Room Microphone	PCB Piezotronics	378C20	Microphone and Preamplifier	65617	08/22	
Source Room Microphone	PCB Piezotronics	378C20	Microphone and Preamplifier	63739	04/22	
Source Room Microphone	PCB Piezotronics	378C20	Microphone and Preamplifier	63742	04/22	
Source Room Microphone	PCB Electronics	378C20	Microphone and Preamplifier	64906	04/22	
Source Room Environmental Indicator	Comet	T7510	Temperature and Humidity Transmitter	63810	10/22	
Tapping Machine	Norsonic	Nor277	Tapping Machine	INT00936	02/22	

* The calibration frequency for this equipment is every two years per the manufacturer's recommendation.

VT RECEIVE ROOM VOLUME	155.77 m ³
VT SOURCE ROOM VOLUME	190 m ³

**SECTION 6
LIST OF OFFICIAL OBSERVERS**

NAME	COMPANY
Corey S. Kohler	Intertek B&C
Daniel B. Mohler	Intertek B&C

TEST REPORT FOR ONEFLOR USA

Report No.: P6745.01-113-11-R0

Date: 01/24/23

SECTION 7**TEST PROCEDURE**

The microphones were calibrated before conducting the tests. The air temperature and relative humidity conditions were monitored and recorded during all measurements. The average temperature and humidity of both the source and receive rooms are listed in Sections 10 and 11. The maximum and minimum temperatures and humidities of the receive room from the duration of the test are listed in Sections 12 and 13.

The airborne transmission loss test was conducted in accordance with the ASTM E90 test method using the single direction method. Two background noise sound pressure level and five sound absorption measurements were conducted at each of five microphone positions. Two sound pressure level measurements were made simultaneously in both rooms, at each of five microphone positions.

The impact sound transmission test was conducted in accordance with the ASTM E492 test method. Two background noise sound pressure level, two sound pressure level measurements with the tapping machine operating at each position specified by ASTM E492, and five sound absorption measurements were conducted at each of five microphone positions.

Detailed test procedures, data for flanking limit tests, repeatability measurements, and reference specimen tests are available upon request.

SECTION 8**TEST CALCULATIONS**

The STC (Sound Transmission Class), IIC (Impact Insulation Class), and HIIC (High-Frequency Impact Insulation Class) ratings were calculated in accordance with ASTM E413, ASTM E989, and ASTM E3222, respectively.

TEST REPORT FOR ONEFLOR USA

Report No.: P6745.01-113-11-R0

Date: 01/24/23

SECTION 9

TEST SPECIMEN DESCRIPTION

MATERIAL	DIMENSIONS (mm)	THICKNESS (mm)	MANUFACTURER AND SERIES	QUANTITY	AVERAGE WEIGHT
LVT Flooring	1219.2 by 152.4	3.5	OneFlor Setagrip/SetaDB/ Cling/Cling Comfort	10.98 m ²	4.25 kg/m ²
	Note: The floor topping was bonded to the gypsum concrete with the Setagrip bonding system.				
Gypsum Concrete	3023 by 3632	19.1	USG Levelrock® Brand 2500	10.98 m ²	36.62 kg/m ²
	Note: Poured directly onto the subfloor underlayment, cured a minimum of 14 days. The gypsum panel had a closed cell foam perimeter isolation. No noticeable shrinkage or cracking was visible on the specimen.				
Oriented Strand Board Sheathing	1219 by 2438	18.8	N/A	10.98 m ²	11.67 kg/m ²
	Note: Adhered to the floor trusses with Loctite PL 400 Subfloor adhesive. Fastened with 9D nails on 203 mm centers along perimeter and 305 mm centers along trusses.				
Fiberglass Insulation	520.7 by 3023	88.9	Johns Manville Unfaced R-13	10.98 m ²	1.32 kg/m ²
	Note: Installed in the cavity between trusses, stapled flush with the subfloor				
Open Web Truss	88.9 by 2933.7	457.2	York PB Truss L/360	7 trusses	19.05 kg/truss
	Note: Installed on 610 mm centers using JUS414 hanger brackets.				
Resilient Channel	68.6 by 3454.4	12.7	ClarkDietrich RC Deluxe™	31.05 lin m	0.33 kg/m
	Note: Installed on 305 mm centers perpendicular to the trusses. The measured thickness of the metal was 0.7 mm.				
Gypsum Panel	1219 by 3023	15.9	National Gypsum Gold Bond® Fire-Shield C™	10.98 m ²	10.74 kg/m ²
	Note: Fastened to the channels on 305 mm centers with 25.4 mm Type S bugle head screws. The seams of the gypsum panels were sealed with Pecora AC-20 FTR caulk and covered with pressure sensitive tape.				

TEST REPORT FOR ONEFLOR USA

Report No.: P6745.01-113-11-R0

Date: 01/24/23

SECTION 10

TEST RESULTS - AIRBORNE SOUND TRANSMISSION LOSS



TEST DATE	1/23/2023				
DATA FILE NO.	P6745.01				
CLIENT	OneFlor USA				
DESCRIPTION	3.5 mm OneFlor Setagrip/SetaDB/Cling/Cling Comfort LVT Flooring, 19.05 mm USG Levelrock® Brand 2500 Gypsum Concrete, 18.8 mm Oriented Strand Board Sheathing, 88.9 mm Johns Manville Unfaced R-13 Fiberglass Insulation, 457.2 mm York PB Truss L/360 Open Web Truss, 12.7 mm ClarkDietrich RC Deluxe™ Resilient Channel, 15.9 mm National Gypsum Gold Bond® Fire-Shield C™ Gypsum Panel				
SPECIMEN AREA	10.98 m ²	Receive Temp.	18°C	Source Temp.	18.9°C
TECHNICIAN	CSK	Receive Humidity	56%	Source Humidity	56%

FREQ (Hz)	BACKGROUND SPL (dB)	ABSORPTION m ²	SOURCE SPL (dB)	RECEIVE SPL (dB)	SPECIMEN TL (dB)	95% SAMPLING LIMIT	NUMBER OF DEFICIENCIES
50	37.4	25.5	107	74	30	3.3	-
63	37.2	17.6	105	71	33	5.0	-
80	40.7	14.9	101	66	35	3.3	-
100	25.8	8.9	98	65	36	1.8	-
125	27.8	10.1	102	61	42	2.4	2
160	25.3	9.3	102	60	43	1.3	4
200	21.9	9.8	98	51	48	1.5	2
250	18.5	9.6	100	50	51	1.2	2
315	22.4	9.1	103	54	51	1.1	5
400	19.9	8.3	103	51	54	0.8	5
500	19.3	8.1	100	45	57	0.9	3
630	23.6	8.3	99	41	59	0.5	2
800	22.4	7.8	99	40	61	0.6	1
1000	23.3	7.9	100	39	62	0.5	1
1250	20.8	8.0	100	37	65	0.4	0
1600	18.5	8.3	100	37	65	0.4	0
2000	16.2	8.9	100	36	65	0.3	0
2500	13.9	10.0	95	32	64	0.4	0
3150	11.7	10.9	93	29	64	0.2	0
4000	11.0	11.7	93	26	67	0.5	0
5000	10.9	14.1	91	20	70	0.7	-
6300	11.1	17.4	89	13	75	0.6	-
8000	10.8	21.9	91	12	77	0.9	-
10000	11.0	21.9	89	11	76	1.3	-
STC Rating	60	<i>(Sound Transmission Class)</i>			Sum of Deficiencies	27	

- Notes:**
- 1) Receive Room levels less than 5 dB above the Background levels are highlighted in yellow.
 - 2) Specimen TL levels listed in red are potentially limited by the laboratory flanking limit.
 - 3) Specimen TL levels listed in blue indicate the lower limit of the transmission loss.
 - 4) Specimen TL levels listed in green indicate that there has been a filler wall correction applied

TEST REPORT FOR ONEFLOR USA

Report No.: P6745.01-113-11-R0


Date: 01/24/23

SECTION 11

TEST RESULTS - AIRBORNE SOUND TRANSMISSION LOSS GRAPH



TEST DATE	1/23/2023				
DATA FILE NO.	P6745.01				
CLIENT	OneFlor USA				
DESCRIPTION	3.5 mm OneFlor Setagrip/SetaDB/Cling/Cling Comfort LVT Flooring, 19.05 mm USG Levelrock® Brand 2500 Gypsum Concrete, 18.8 mm Oriented Strand Board Sheathing, 88.9 mm Johns Manville Unfaced R-13 Fiberglass Insulation, 457.2 mm York PB Truss L/360 Open Web Truss, 12.7 mm ClarkDietrich RC Deluxe™ Resilient Channel, 15.9 mm National Gypsum Gold Bond® Fire-Shield C™ Gypsum Panel				
SPECIMEN AREA	10.98 m ²	Receive Temp.	18°C	Source Temp.	18.9°C
TECHNICIAN	CSK	Receive Humidity	56%	Source Humidity	56%

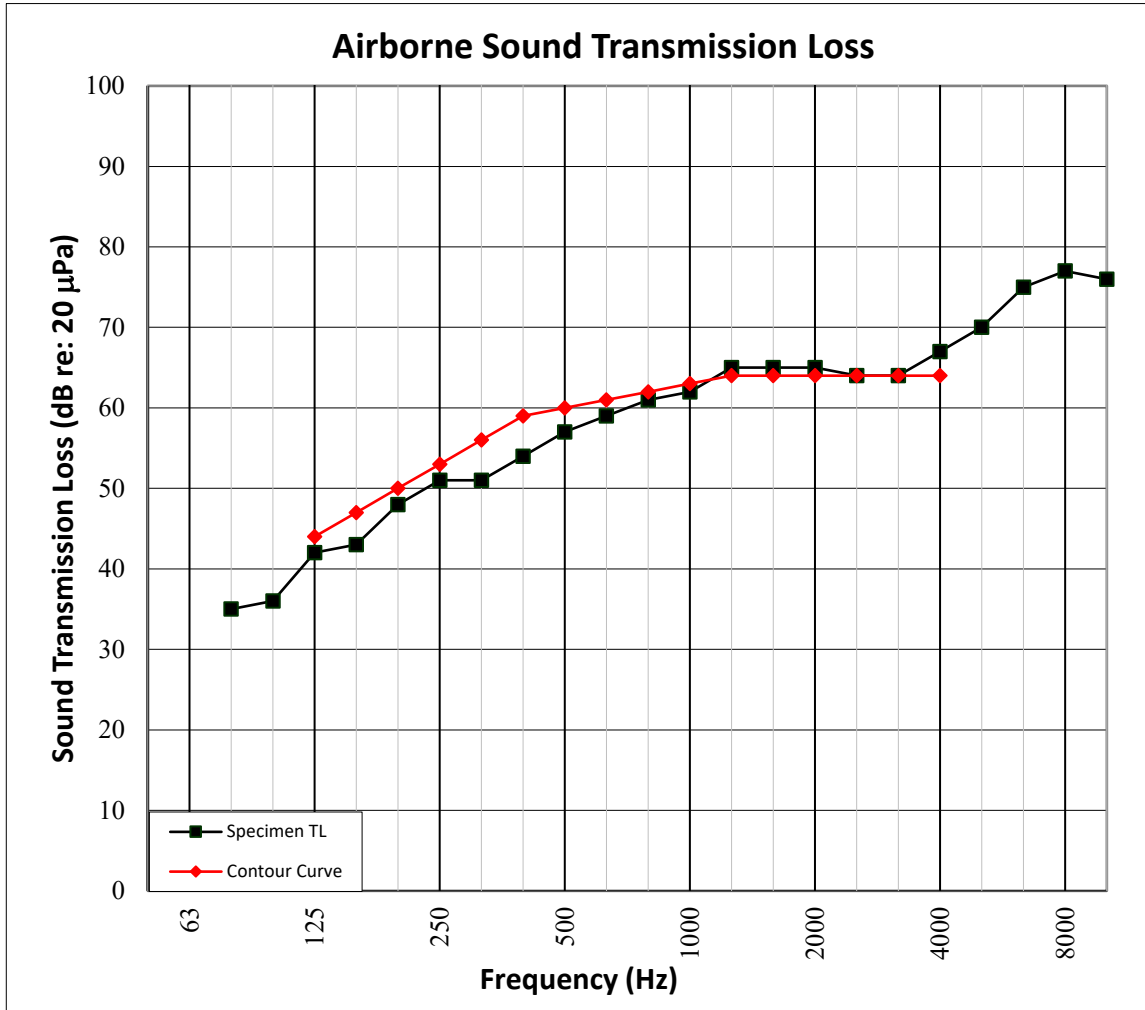

TEST REPORT FOR ONEFLOR USA

Report No.: P6745.01-113-11-R0

Date: 01/24/23

SECTION 12

TEST RESULTS - IMPACT SOUND TRANSMISSION



TEST DATE	1/23/2023				
DATA FILE NO.	P6745.01				
CLIENT	OneFlor USA				
DESCRIPTION	3.5 mm OneFlor Setagrip/SetaDB/Cling/Cling Comfort LVT Flooring, 19.05 mm USG Levelrock® Brand 2500 Gypsum Concrete, 18.8 mm Oriented Strand Board Sheathing, 88.9 mm Johns Manville Unfaced R-13 Fiberglass Insulation, 457.2 mm York PB Truss L/360 Open Web Truss, 12.7 mm ClarkDietrich RC Deluxe™ Resilient Channel, 15.9 mm National Gypsum Gold Bond® Fire-Shield C™ Gypsum Panel				
SPECIMEN AREA	10.98 m ²	Maximum Temp.	18.1°C	Minimum Temp.	18°C
TECHNICIAN	CSK	Max. Humidity	56%	Min. Humidity	56%

FREQ (Hz)	BACKGROUND SPL (dB)	ABSORPTION m ²	NORMALIZED IMPACT SPL (dB)	95% SAMPLING LIMIT	NUMBER OF DEFICIENCIES
80	42.0	15.2	69	1.6	-
100	33.0	9.7	67	1.5	7
125	33.1	9.6	65	1.3	5
160	33.9	9.0	65	0.9	5
200	26.2	9.6	65	0.9	5
250	25.3	9.5	61	0.4	1
315	25.4	9.2	61	0.5	1
400	24.9	8.7	61	0.5	2
500	22.4	8.2	54	0.3	0
630	25.5	8.1	49	0.5	0
800	24.5	7.8	45	0.4	0
1000	24.0	7.8	41	0.3	0
1250	22.1	8.0	41	0.3	0
1600	19.4	8.3	39	0.5	0
2000	16.8	9.0	42	0.4	0
2500	14.5	9.9	40	0.3	0
3150	12.4	10.8	33	0.3	0
4000	11.8	11.9	28	0.4	-
5000	11.2	14.2	25	0.4	-
6300	11.3	17.2	20	0.7	-
8000	11.5	21.5	17	1.0	-
10000	11.4	21.5	15	1.0	-
IIC Rating	52	<i>(Impact Insulation Class)</i>		Sum of Deficiencies	26

Notes: Receive Room levels less than 5 dB above the Background levels are highlighted in yellow.

TEST REPORT FOR ONEFLOR USA

Report No.: P6745.01-113-11-R0


Date: 01/24/23

SECTION 13

TEST RESULTS - IMPACT SOUND TRANSMISSION GRAPH



TEST DATE	1/23/2023				
DATA FILE NO.	P6745.01				
CLIENT	OneFlor USA				
DESCRIPTION	3.5 mm OneFlor Setagrip/SetaDB/Cling/Cling Comfort LVT Flooring, 19.05 mm USG Levelrock® Brand 2500 Gypsum Concrete, 18.8 mm Oriented Strand Board Sheathing, 88.9 mm Johns Manville Unfaced R-13 Fiberglass Insulation, 457.2 mm York PB Truss L/360 Open Web Truss, 12.7 mm ClarkDietrich RC Deluxe™ Resilient Channel, 15.9 mm National Gypsum Gold Bond® Fire-Shield C™ Gypsum Panel				
SPECIMEN AREA	10.98 m ²	Maximum Temp.	18.1°C	Minimum Temp.	18°C
TECHNICIAN	CSK	Max. Humidity	56%	Min. Humidity	56%

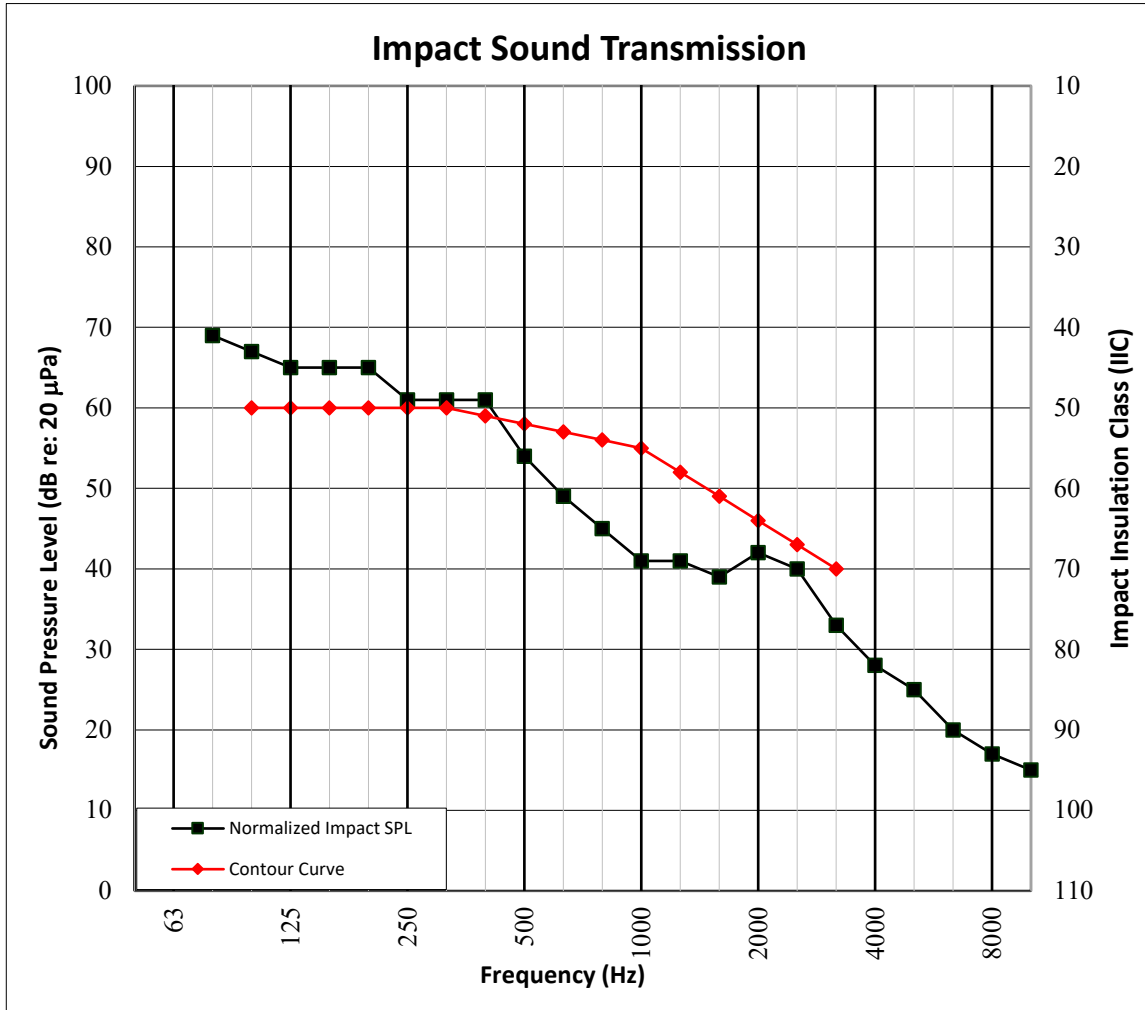

TEST REPORT FOR ONEFLOR USA

Report No.: P6745.01-113-11-R0

Date: 01/24/23

SECTION 14

TEST RESULTS - HIGH-FREQUENCY IMPACT SOUND TRANSMISSION



TEST DATE	1/23/2023				
DATA FILE NO.	P6745.01				
CLIENT	OneFlor USA				
DESCRIPTION	3.5 mm OneFlor Setagrip/SetaDB/Cling/Cling Comfort LVT Flooring, 19.05 mm USG Levelrock® Brand 2500 Gypsum Concrete, 18.8 mm Oriented Strand Board Sheathing, 88.9 mm Johns Manville Unfaced R-13 Fiberglass Insulation, 457.2 mm York PB Truss L/360 Open Web Truss, 12.7 mm ClarkDietrich RC Deluxe™ Resilient Channel, 15.9 mm National Gypsum Gold Bond® Fire-Shield C™ Gypsum Panel				
SPECIMEN AREA	10.98 m ²	Maximum Temp.	18.1°C	Minimum Temp.	18°C
TECHNICIAN	CSK	Max. Humidity	56%	Min. Humidity	56%

FREQ (Hz)	BACKGROUND SPL (dB)	ABSORPTION m ²	NORMALIZED IMPACT SPL (dB)	95% SAMPLE CONFIDENCE LIMIT	NUMBER OF DEFICIENCIES
400	24.9	8.7	61	0.5	8.6
500	22.4	8.2	54	0.3	3.1
630	25.5	8.1	49	0.5	0.0
800	24.5	7.8	45	0.4	0.0
1000	24.0	7.8	41	0.3	0.0
1250	22.1	8.0	41	0.3	0.0
1600	19.4	8.3	39	0.5	0.0
2000	16.8	9.0	42	0.4	2.9
2500	14.5	9.9	40	0.3	4.5
3150	12.4	10.8	33	0.3	0.0
HiIC Rating	59	<i>(High-Frequency Impact Insulation Class)</i>		Sum of Deficiencies	19.2

Notes: Receive Room levels less than 5 dB above the Background levels are highlighted in yellow.

TEST REPORT FOR ONEFLOR USA

Report No.: P6745.01-113-11-R0


Date: 01/24/23

SECTION 15

TEST RESULTS - HIGH-FREQUENCY IMPACT SOUND TRANSMISSION GRAPH



TEST DATE	1/23/2023				
DATA FILE NO.	P6745.01				
CLIENT	OneFlor USA				
DESCRIPTION	3.5 mm OneFlor Setagrip/SetaDB/Cling/Cling Comfort LVT Flooring, 19.05 mm USG Levelrock® Brand 2500 Gypsum Concrete, 18.8 mm Oriented Strand Board Sheathing, 88.9 mm Johns Manville Unfaced R-13 Fiberglass Insulation, 457.2 mm York PB Truss L/360 Open Web Truss, 12.7 mm ClarkDietrich RC Deluxe™ Resilient Channel, 15.9 mm National Gypsum Gold Bond® Fire-Shield C™ Gypsum Panel				
SPECIMEN AREA	10.98 m ²	Maximum Temp.	18.1°C	Minimum Temp.	18°C
TECHNICIAN	CSK	Max. Humidity	56%	Min. Humidity	56%

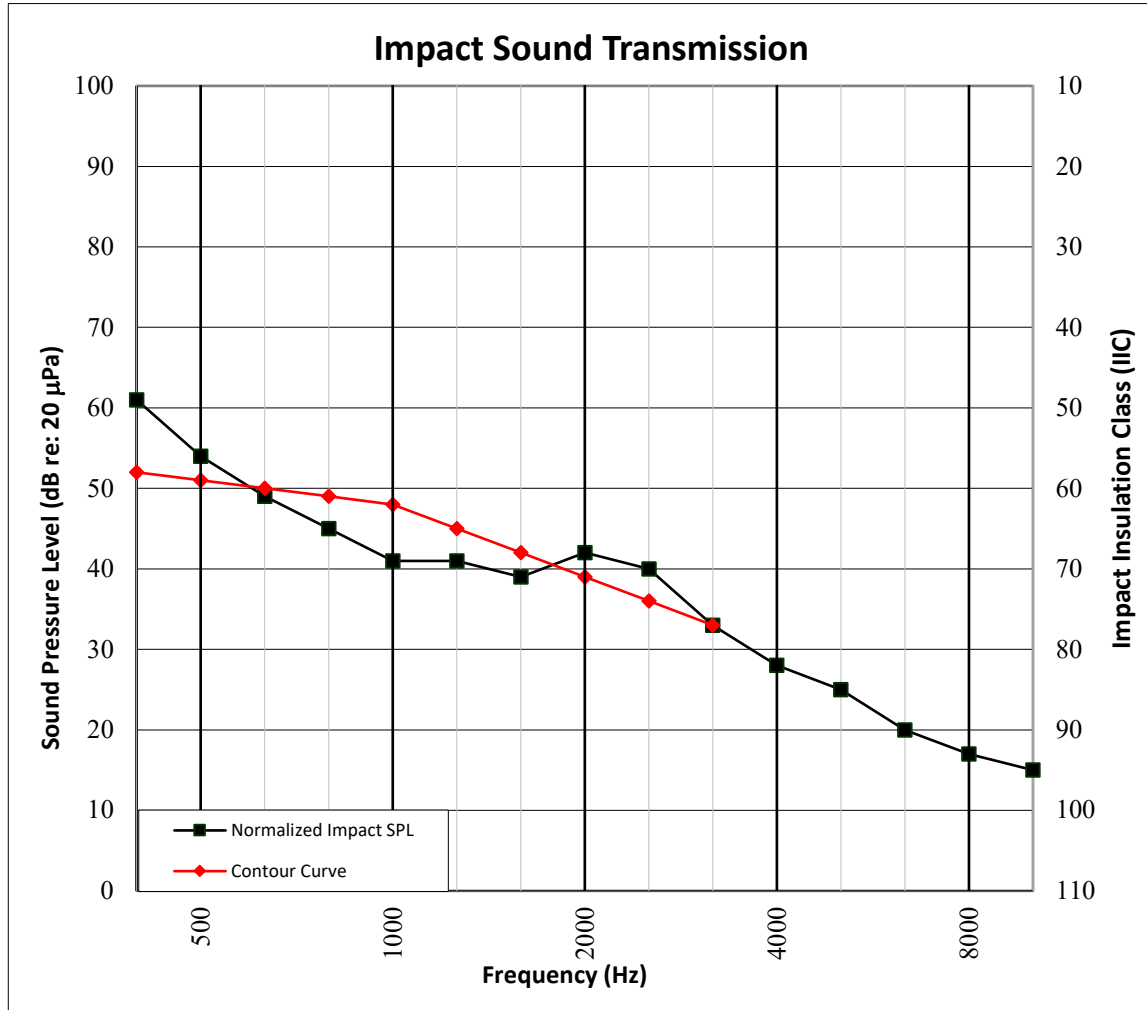

TEST REPORT FOR ONEFLOR USA

Report No.: P6745.01-113-11-R0

Date: 01/24/23

SECTION 16

PHOTOGRAPHS



Photo No. 1

Source Room View of Test Specimen Installation



Photo No. 2

Receive Room View of Test Specimen Installation


TEST REPORT FOR ONEFLOR USA

Report No.: P6745.01-113-11-R0

Date: 01/24/23

SECTION 17

DRAWING

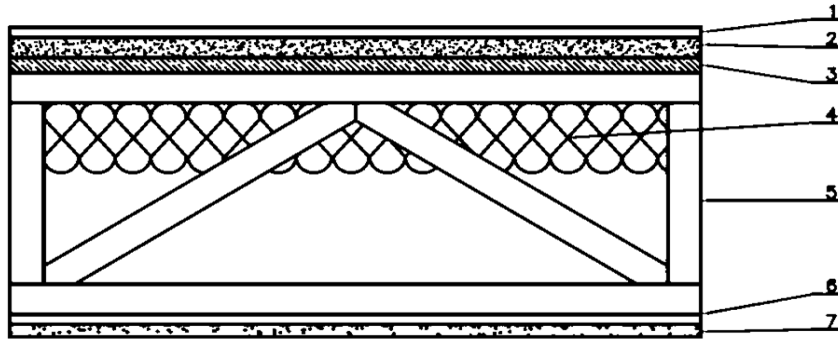

- 1-Floor Topping
- 2-Subfloor Topping
- 3-Subfloor
- 4-Insulation
- 5-Truss
- 6-Ceiling Isolation
- 7-Ceiling

TEST REPORT FOR ONEFLOR USA

Report No.: P6745.01-113-11-R0

Date: 01/24/23

SECTION 18

REVISION LOG

REVISION #	DATE	PAGES	DESCRIPTION
R0	01/24/23	N/A	Original Report Issue